



# TRINITY

MAKING ENERGY MATTER

## XPERT - PRO ELECTRIC POWER METER










The electrical power meter, XPERT-PRO is a micro-controller based unit which measures various electrical parameters, and sequentially displays on a 128X64 backlit LCD.

The unit measures the three phase voltages, currents, frequency, power factors, individual Harmonic data as Histogram including Total Harmonic Distortion as well as individual current and voltage waveforms for all three phases.

The unit is fully solid state and will give years of trouble-free service once installed correctly.



### FEATURES

-  Compact 96X96X65 mm.
-  Graphical Display 128X64
-  Accuracy: Class 1.0 & Class 0.5 (Optionally).
-  Odd Harmonics up to 15th of individual Voltage and Current Waveform including THD.
-  RS-485 port for communication with EMS/PLS/SCADA with RX/TX dual color led indication.
-  Two Relays-Individually programmable for Alarm/Trip with led indication.
-  Histogram & Tabular display of Harmonics content.
-  Wave shape display for all voltage & currents.
-  Kwh Energy Pulse output on the LED (1000 impulses/KWh)

## TRINITY ENERGY SYSTEMS PVT LTD

386, Savli G.I.D.C. Industrial Estate, Nr. Manjusar, At & Po: Alindra, Tal.: Savli, Dist. Vadodara - 391775 Gujarat, INDIA  
Phone: +91-922 800 4452/53/54, Email: [info@trinityenergy.co.in](mailto:info@trinityenergy.co.in) | [www.trinityenergy.co.in](http://www.trinityenergy.co.in)



## Comprehensive Measurement



All readings are True RMS measurements.



Measurement of three energies: KWh, KVAh, KVARh



Odd Harmonics upto 15th of individual Voltage and Current Waveform including THD.



KVA and KW Demand



## Installation and Connections



Single Model Accepts 3P4W, 3P3W and 1P2W connections



1A and 5A CT secondary selectable



User selectable CT and PT Ratio.



## Communication

XPERT-PRO has a communication port, RS485 for connection to SCADA/EMS.



## Control


The unit has two relay contacts which are programmable to operate for Alarm/Trip functions with the following parameters including (Sliding) Demand powers (KW and KVA).

Sr No.	Alarm Parameters	Relays Switches on at	Relay Switches off at	Settable Time Delay
1.	Avg. Volts	>Set value	<95% of set value	005 to 180 sec
2.	Avg. Amps.	>Set value	<95% of set value	005 to 180 sec
3.	KVA	>Set value	<95% of set value	005 to 180 sec
4.	KW	>Set value	<95% of set value	005 to 180 sec
5.	KVAR	>Set value	<95% of set value	005 to 180 sec
6.	Demands	>Set value	<95% of set value	2 sec.(fixed)
7.	PF	<Set value	>Set value	005 to 180 sec.



## Other-features

Graphical LC display of 128X64 monochrome (Black and white) makes it possible to display harmonic data in histogram waveforms of all voltage and currents.

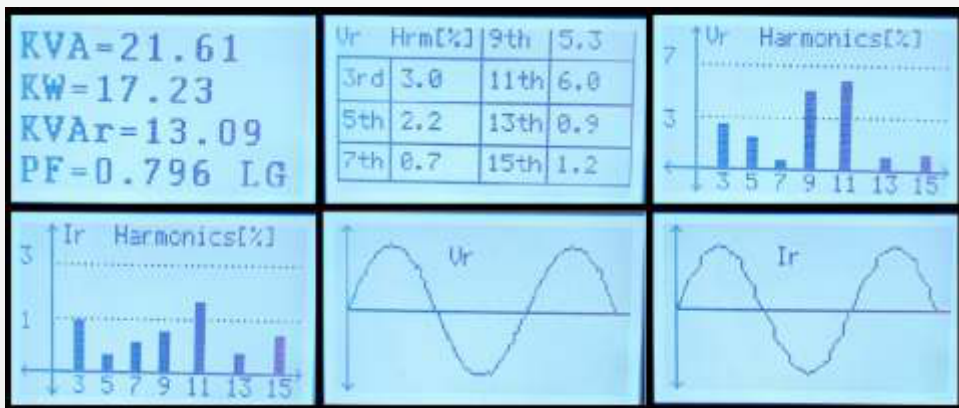

# TECHNICAL SPECIFICATIONS

Parameter		
Type	Name	Statistics
INPUT	Supply	Three Phases and Neutral of a 3P4W system / Three Phases of a 3P3W system & Phase and Neutral of a 1P2W system
	Voltage	Direct Voltage Input : Up to 500V L-L, Up to 300V L-N PT Ratio : Site Selectable Burden : 0.5VA
	Current	Secondary Current Input: 5A or 1A (Site Selectable) CT Ratio : Site Selectable Range of Reading : 5 – 5000A Burden : < 1.0VA Overload : 5A CT = 6A RMS Continuous 1A CT = 1.2A RMS Continuous
	Power Supply	Auxiliary Supply : 80 - 270 VAC, 50-60 Hz.
OUTPUT	Relay	Two. Individually Field Programmable. 3A @ 230 VAC, Resistive Load
MEASUREMENT	True RMS Basic Parameters	Voltage (Volts L-N & L-L) VL-N - Accuracy : 0.5% of Reading VL-L - Accuracy : 1.0% of Reading
		Current (Amps IR, IY, IB) Accuracy : 0.25% of Reading
		Line Frequency 45 to 65 Hz, Accuracy : 0.3% of Reading
	Power	Active Power (P) Accuracy: 1% of Reading (For IPFI>0.5)
		Reactive Power (Q) Accuracy: 1.5% of Reading (Between 0.5 Lag to 0.8 Lead)
		Apparent Power (S) Accuracy: 1% of Reading
		Power Factor For Individual phases and System Accuracy: 1.0% of Reading (IPFI≥0.5) Range of Reading: 0.05 to 1.00 Lag/Lead
	Energy	Total Active Energy (KWh) Range of Reading: 0 to 9999999.9 Accuracy: 1.0S as per IS13779
		Total Apparent Energy (KVAh) Range of Reading: 0 to 9999999.9 Accuracy: 1.0% of Reading
		Total Reactive Energy (KVARh) Range of Reading: 0 to 9999999.9 Accuracy: 1.5% of Reading
	Power Quality	Individual waveform for each voltage and current
		THD for each voltage and current
	Demand	KVA/ KWA Demand Site Selectable. Demand Interval 15/30 Min. Also site selectable
		Max. Demand Max. Value reached only. No time & date stamp
MISCELLANEOUS	Dimensions	Bezel 96 X 96 mm
		Panel Cutout 92 X 92 mm
		Depth of installation 65 mm
		Display 128X64 LCD
		Operating temp 10°C to 50°C
		Weight 0.35 Kgs (Approx.)
		Min. Operating Current 0.4% of CT primary
	Comm.	RS485 Modbus-RTU protocol
		Calibration LED. Red color. 1000 impulses/unit(basic) for KWh
		Communication LED Dual color LED. Data Receive - Green LED. Data Transmit - Red LED.
		Relay LED 2 Red Color for Relay ON Indication.